

Victaulic Vortex™ 1000 Fire Suppression System



The Victaulic Vortex 1000 fire suppression system is a hybrid system incorporating liquid (water) and inert gas (nitrogen) extinguishing agents discharged together from a single emitter.

Using proprietary supersonic technology, the system atomizes the water to <math><10\mu\text{m}</math> forming a dense homogeneous suspension of nitrogen and water. In this manner two extinguishment mechanisms are occurring simultaneously: cooling and oxygen reduction.



Series 953 Emitter



Series 951 Addressable
Combination Box

PATENT-PENDING

APPLICATION

The Victaulic Vortex 1000 Fire Suppression System can effectively be applied in total flooding fire suppression applications in the following areas:

- Industrial machine spaces such as power generation plants, turbine enclosures, automotive manufacturing, steel foundry
- Flammable liquids storage

Environmental Impact

Since the Victaulic Vortex 1000 system only discharges pure nitrogen and water, there are no environmental or life-safety risks as a result of a system discharge. The Environmental Protection Agency Significant New Alternatives Policy (SNAP) approval recognizes the Victaulic Vortex homogenous suspension discharge as a suitable replacement for Halon 1301. The system can be discharged immediately upon hazard detection, without a delay for occupant evacuation.

OPERATION

The system is fully compatible with automatic hazard detection systems and is adaptable for remote manual activation if required.

A system installation and maintenance manual is available containing information on system components and procedures concerning design, operation, inspection, maintenance and recharge.

The Victaulic Vortex 1000 system is particularly useful for suppressing fires in hazards where an electrically non-conductive medium is essential or desirable, where clean up of other agents present a problem, room integrity is not possible, or where the hazard is normally occupied and requires a non-toxic agent.

The basic system consists of stored nitrogen and either municipal or captive water supply, water piping along with single or multiple zone control boxes and system emitters in the hazard area. The suspension of water and nitrogen is distributed and discharged into the hazard area through a twin piping network and emitters. System emitters can be installed in pendent configuration and are positioned via straight-forward cubic-foot/meter coverage volume requirements.

JOB/OWNER

System No. _____

Location _____

CONTRACTOR

Submitted By _____

Date _____

ENGINEER

Spec Sect _____ Para _____

Approved _____

Date _____

Victaulic Vortex™ 1000 Fire Suppression System


REGULATORY INFORMATION

The Victaulic Vortex 1000 system is FM Approved under the FM5580 standard for Fixed Extinguishing Systems, Hybrid (Water and Inert Gas) for the protection of combustion turbines, machinery spaces, and special hazard machinery spaces in enclosures with volumes not exceeding 127,525 ft³/3600 m³ and a maximum height of 24.6 ft/7.5 m.

INSTALLATION

All system components and accessories must be installed by personnel trained by the manufacturer. All installation must be performed according to the guidelines stated in the manufacturer's design, installation, operation, inspection, recharge and maintenance manual. See publication: I-VORTEX.FM.

TYPICAL SYSTEM LAYOUT

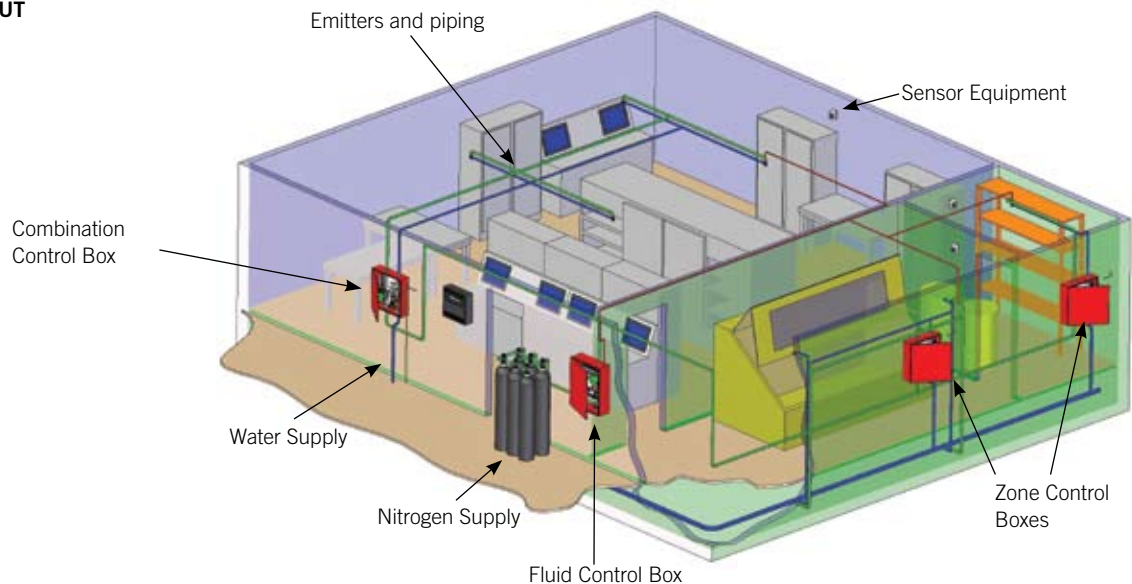

WARRANTY

Refer to the Warranty section of the current Price List or contact Victaulic for details.

NOTE

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

For complete contact information, visit www.victaulic.com

70.01 5300 REV B UPDATED 5/2009

VICTAULIC IS A REGISTERED TRADEMARK OF VICTAULIC COMPANY. © 2009 VICTAULIC COMPANY. ALL RIGHTS RESERVED.

70.01